




TEMPERATURE CONTROL FOR TODAY & TOMORROW

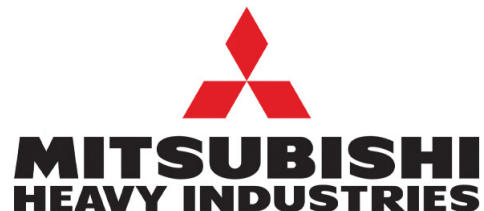

FDE100VSAWPVH

10.0 KW



Unitate internă : FDE50VH-x-2



Unitate externă : FDC100VSA-W


Specificații tehnice

R32

Unitate internă		FDE50VH x 2	
Unitate externă		FDC100VSA-W	
Sursă de alimentare		Trifazic 380-415V, 50Hz / 380V, 60Hz	
Capacitate nominală de răcire (Min-Max)		kW	10.0 (4.0 ~ 11.2)
Capacitate nominală de încălzire (Min-Max)		kW	11.2 (4.0 ~ 12.5)
Power Consumption	Răcire/Încălzire	kW	3.12 / 2.99
EER/COP	Răcire/Încălzire	kW	3.21 / 3.75
Curent de intrare		A	5
Max. current		A	15
Nivel putere sonoră*1	U.I.*3	Răcire/Încălzire	60 / 60
	U.E.	Răcire/Încălzire	69 / 70
Nivel presiune sonoră*1	U.I.*3	Răcire (P-Hi/Hi/Me/Lo)	46 / 38 / 36 / 31
		Încălzire (P-Hi/Hi/Me/Lo)	46 / 38 / 36 / 31
	U.E.	Răcire/Încălzire	54 / 56
Flux de aer	U.I.*3	Răcire (P-Hi/Hi/Me/Lo)	13 / 10 / 9 / 7
		Încălzire (P-Hi/Hi/Me/Lo)	13 / 10 / 9 / 7
	U.E.	Răcire/Încălzire	75 / 73
Exterior dimensions	U.I.	HeightxWidthxDepth	mm 210 x 1,070 x 690
	U.E.		mm 845 x 970 x 370
Greutate netă	U.I./U.E.	kg	28 / 78
Refrigerant charge		kg/TCO ₂ E _q	3.3/2.228
Refrigerant Type GWP			R32/675
Ref.piping size	Lichid/Gaz	Ă,mm	9.52(3/8") / 15.88(5/8")
Lungime țevă refrigerant (o direcție)		m	Max. 50
Diferență de nivel suportată	Unitate externă este mai sus/mai jos	m	Max.50 / Max.15
Interval de funcționare - temperatură exterioară	Răcire*2	°C	-15~50
	Încălzire	°C	-20~20
Filteru de aer, cantitate			Pocket plastic net x 2(lavabil)
Telecomandă (opțional)			Cu fir:RC-EX3A, RC-E5, RCH-E3 Wireless:RCN-E-E3
Clasa Energetică (Răcire/Încălzire)			A++/A+
SEER			6.16
SCOP (Climat temperat)			4.10
Pdesign (răcire/încălzire(@-10°C))			10.0/8.5
Annual Electricity Consumption			569/2906
Performanța pe modul încălzire			Climat temperat





TEMPERATURE CONTROL FOR TODAY & TOMORROW

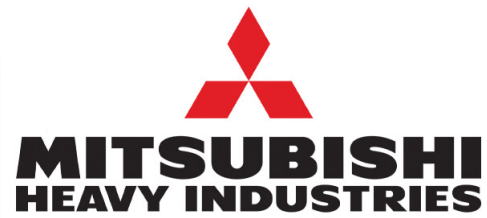




Schema tehnică

Models FDE40VH, 50VH

Note (1) The model name label is attached on the fan casing inside the air return grille.

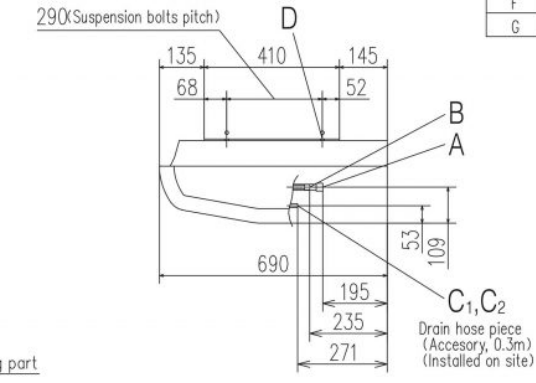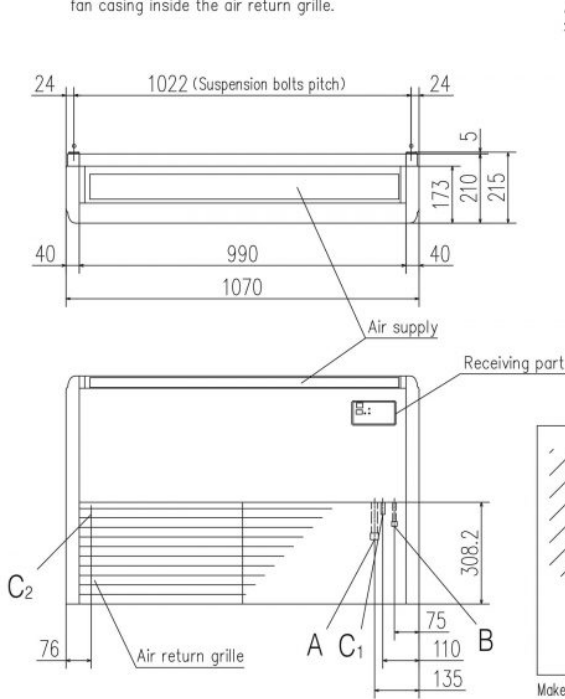

Symbol	Content	
A	Gas piping	∅12.7 (1/2") (Flare)
B	Liquid piping	∅6.35 (1/4") (Flare)
C 1,2	Drain piping	VP20 (I.D.20, O.D.26)
D	Hole for suspension bolts	(M10 or M8)
E	Back cutout	PE cover
F	Top cutout	Plate cover
G	Drain piping (for left back)	(Knock out)

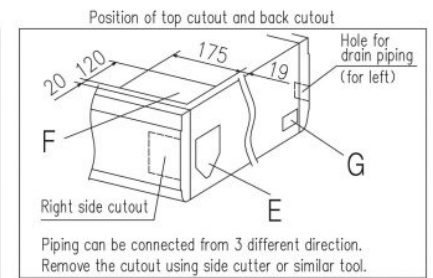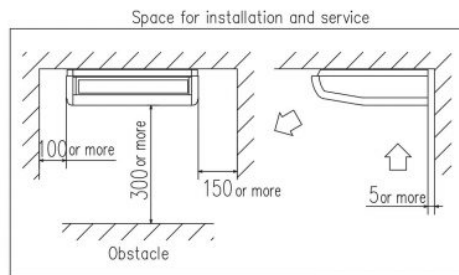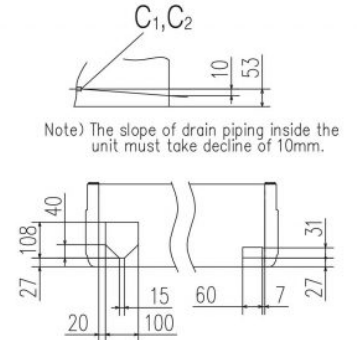

Make a space of 4000 or more between the units when installing more than one.

FDC100VNA, 125VNA, 140VNA
100VSA, 125VSA, 140VSA

Symbol	Content	
A	Service valve connection (gas side)	∅15.88 (5/8") (Flare)
B	Service valve connection (liquid side)	∅9.52 (3/8") (Flare)
C	Pipe/cable draw-out hole	
D	Drain discharge hole	∅20×3places
E	Anchor bolt hole	M10×4places
F	Cable draw-out hole	∅30×3places

- Notes
- (1) It must not be surrounded by walls on the four sides.
 - (2) The unit must be fixed with anchor bolts. An anchor bolt must not protrude more than 15mm.
 - (3) Where the unit is subject to strong winds, lay it in such a direction that the blower outlet faces perpendicularly to the dominant wind direction.
 - (4) Leave 1m or more space above the unit.
 - (5) A wall in front of the blower outlet must not exceed the unit's height.
 - (6) The model name label is attached on the lower right corner of the front panel.

